



NON-WOVEN SEDIMENT CONTROL FABRIC MATERIAL, 60" WIDE ROLLS, USE STAPLES OR WIRE RINGS TO ATTACH FABRIC TO WIRE.

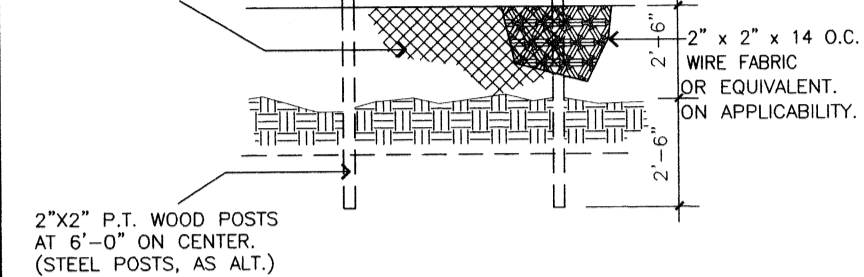


NON-WOVEN SEDIMENT CONTROL FABRIC

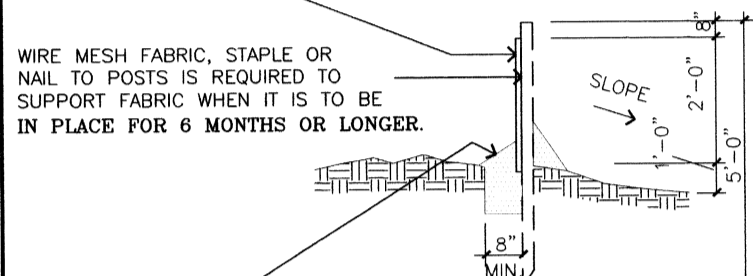

BACKFILL 8"x12" TRENCH W/NATIVE SOIL, AND ON BOTH SIDES OF FILTER FABRIC ON THE SURFACE.


1 FILTER FENCE  
NO SCALE BMP E3.10

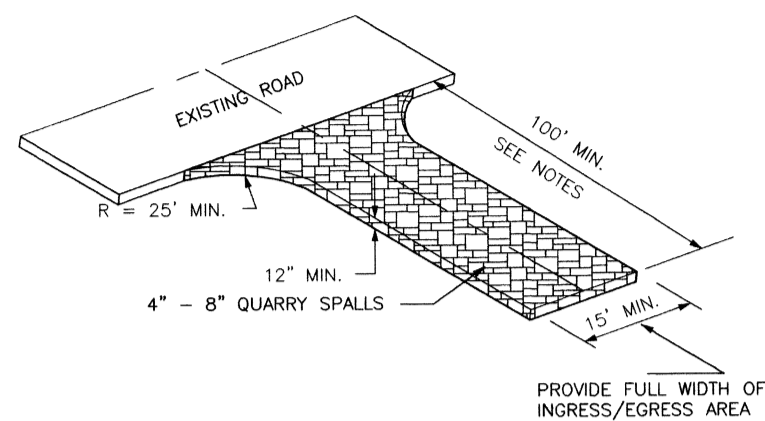


NOTES:

- 100' MINIMUM LENGTH. MAY BE REDUCED TO 50' MINIMUM FOR SITES WITH LESS THAN ONE ACRE OF EXPOSED SOIL.
- ALL MUD AND DEBRIS TRACKED ONTO EXISTING ASPHALTED ROADWAYS SHALL BE SWEEP/CLEANED UP AFTER EACH DAYS WORK, OR AS REQUESTED BY THE PROJECT ENGINEER AND/OR THE CITY INSPECTOR.

2 STABILIZED CONSTRUCTION ENTRANCE  
NO SCALE

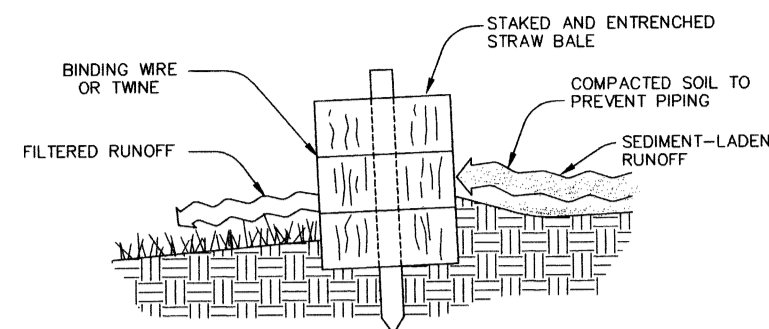

CROSS-SECTION OF PROPERLY INSTALLED STRAW BALE BARRIER

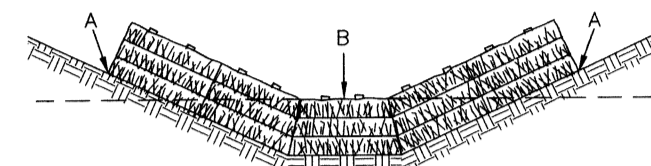


POINTS A SHOULD BE HIGHER THAN POINT B  
PROPER PLACEMENT OF STRAW BALE BARRIER IN DRAINAGE WAY


STRAW BALE BARRIERS

- STRAW BALE BARRIERS SHALL BE INSPECTED IMMEDIATELY AFTER EACH RUNOFF-PRODUCING RAINFALL AND AT LEAST DAILY DURING PROLONGED RAINFALL.
- CLOSE ATTENTION SHALL BE PAID TO THE REPAIR OF DAMAGED BALES, END RUNS, AND UNDERCUTTING BENEATH BALES.
- NECESSARY REPAIRS TO BARRIERS OR REPLACEMENT OF BALES SHALL BE ACCOMPLISHED PROMPTLY.
- SEDIMENT DEPOSITS SHOULD BE REMOVED AFTER EACH RUNOFF-PRODUCING RAINFALL. THEY MUST BE REMOVED WHEN THE LEVEL OF DEPOSITION REACHES APPROXIMATELY ONE-HALF THE HEIGHT OF THE BARRIER.
- ANY SEDIMENT DEPOSITS REMAINING IN PLACE AFTER THE STRAW BALE BARRIER IS NO LONGER REQUIRED SHALL BE DRESSED TO CONFORM TO THE EXISTING GRADE, PREPARED AND SEEDED.
- ALL TEMPORARY AND PERMANENT EROSION AND SEDIMENT CONTROL PRACTICES SHALL BE MAINTAINED AND REPAIRED AS NEEDED TO ASSURE CONTINUED PERFORMANCE OF THEIR INTENDED FUNCTION.

3 STRAW BALE BARRIER  
NO SCALE

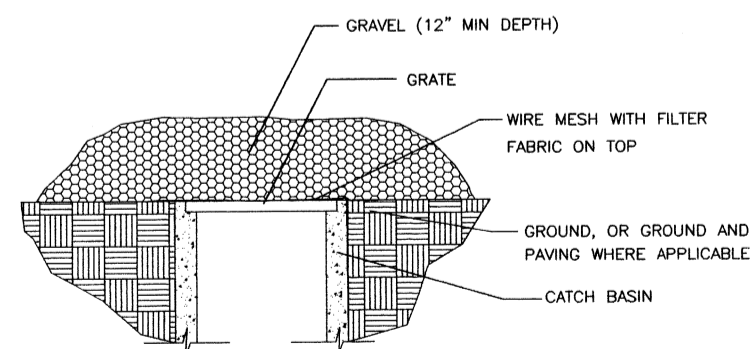


4 INLET PROTECTION  
NO SCALE

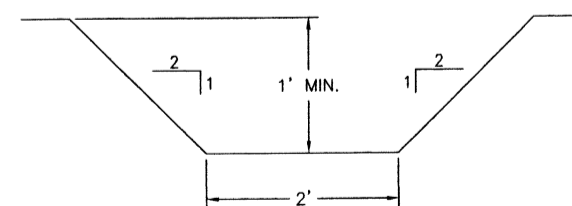


NOTE:  
SEED PER BMP E-1.10, OUTLET TO TEMPORARY SEDIMENTATION POND. RIPRAP AT POND.

5 TEMP ON-SITE INTERCEPTOR SWALE  
NO SCALE

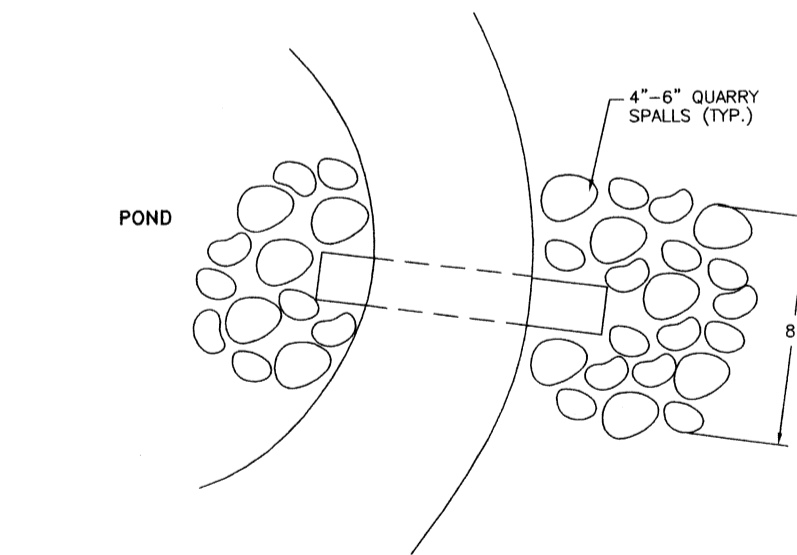

NOTE:  
4"-6" QUARRY SPALLS PER SECTION 9-13.1 OF WSDOT/APWA STANDARD SPECIFICATIONS  
GRADATION: PASS 8" SQUARE SIZE 100%  
PASS 6" SQUARE SIZE 40-60%  
PASS 2" SQUARE SIZE 0-10%

6 TEMPORARY SILT POND OUTLET  
NO SCALE

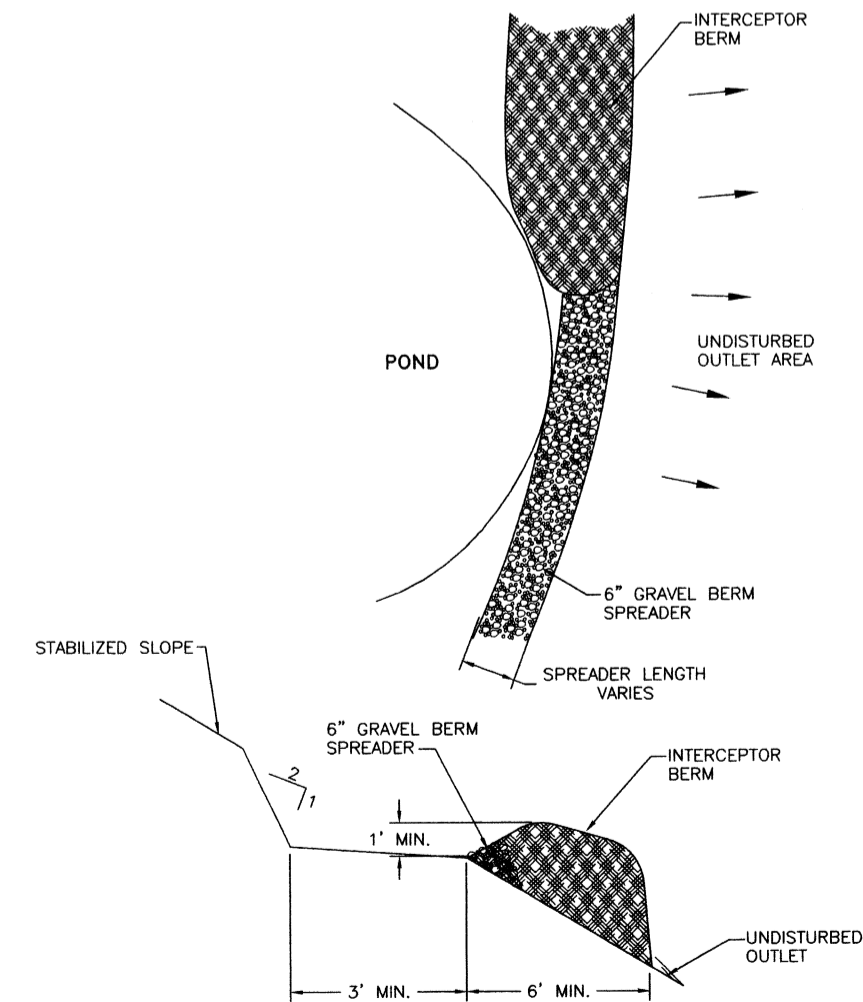

7 LEVEL SPREADER OUTLET  
NO SCALE BMP E2.50

DESIGNED	JAS	2/8/98	REVISIONS	DATE	BY
DRAWN	SBK				
CHECKED	JAS				
DATE	BY				



**SCHEMMER ENGINEERING INC.**  
1004 COMMERCIAL AVENUE, SUITE 105  
ANACORTES, WA 98221-4185 (360) 293-1980

**SUN SYSTEMS, INC.**  
TESC NOTES & DETAILS

JOB NO.	98-012
SHEET	C2
	2 OF 11